


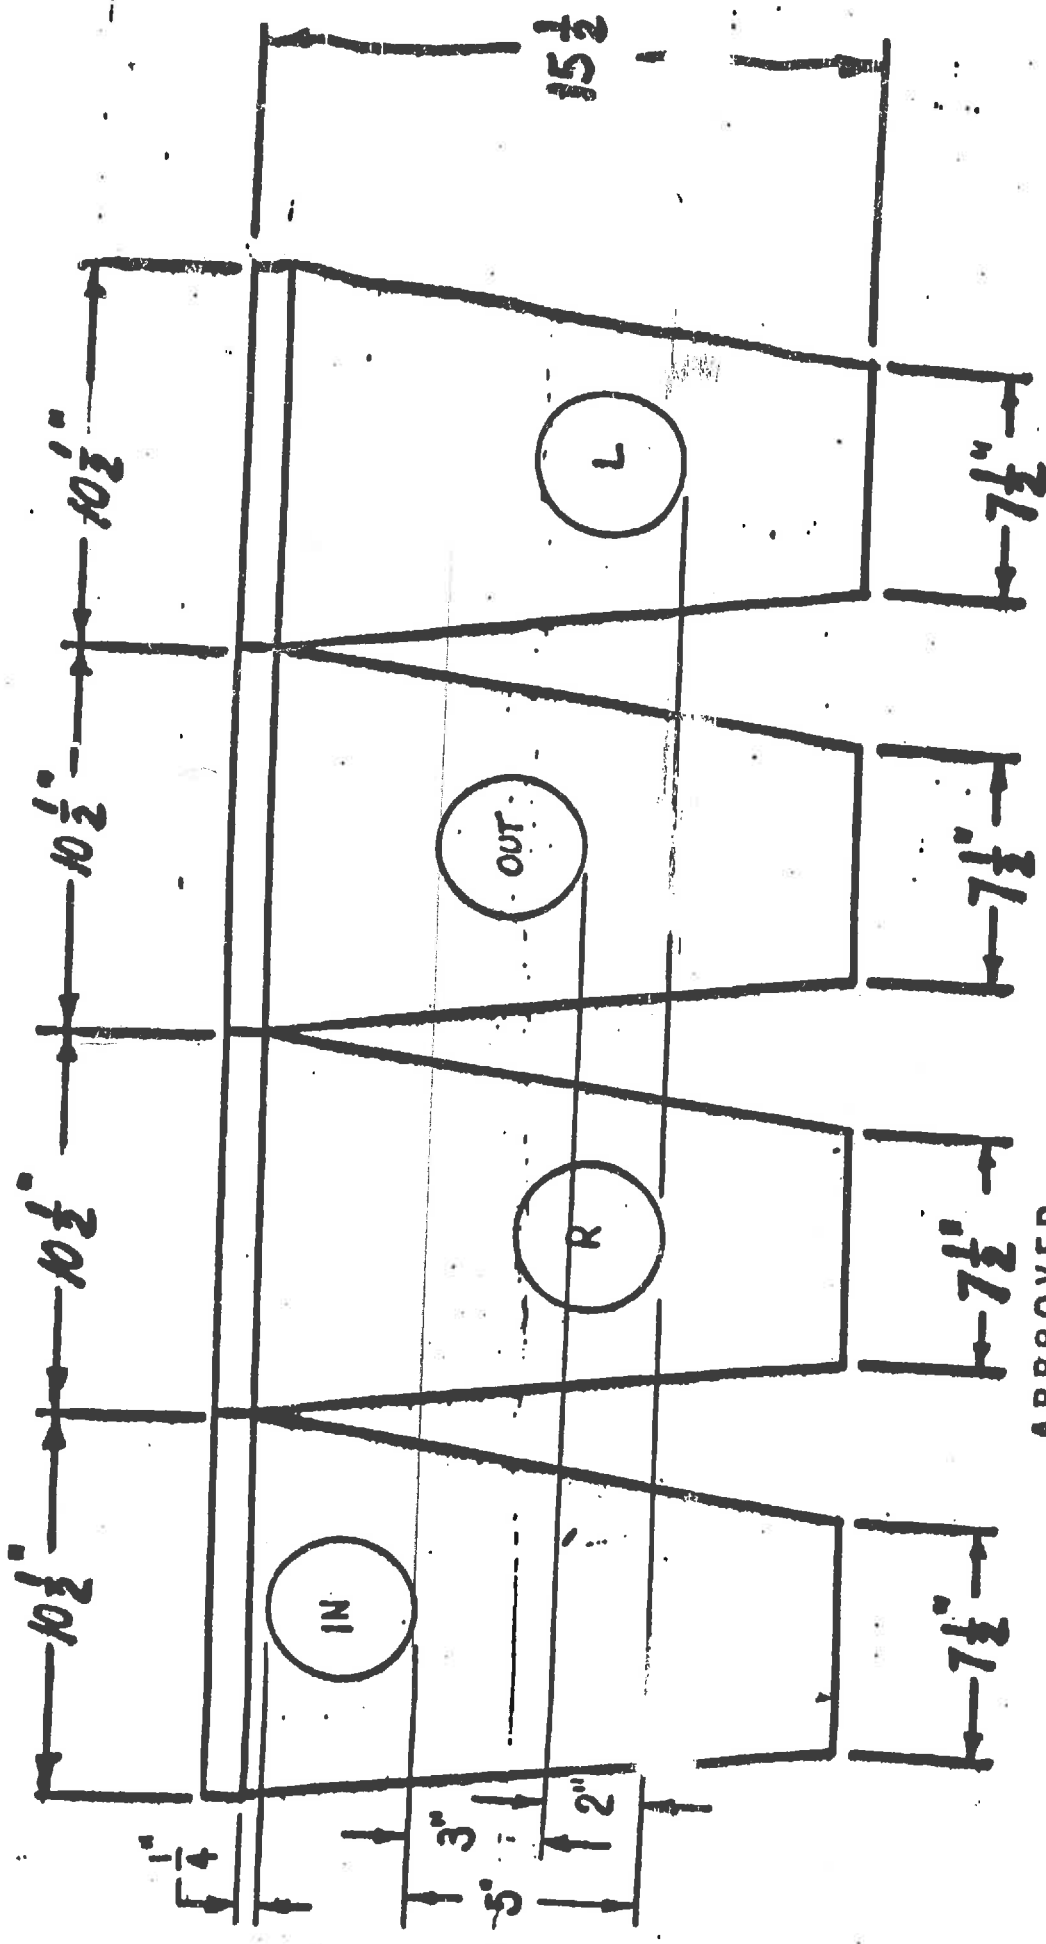

APPROVED

This component meets the minimum requirements for compliance with 902 KAR 10:080; and is approved for use in Kentucky subject to the restrictions, if any, listed below:

Dudley Cooper 1-6-85
 Director, Division of DMN Date
 Consumer Health Protection

KY-PH2-071-C

Assigned Code Number

Restrictions SEE COPYING SHEET

TUF-TITE WUE LOCATIONS
 FOR: KY-2"